

**EQUIPMENT SYSTEM HVAC CHILLED WATER
SINGLE VESSEL DATA STRUCTURE
PHYSICAL AND FUNCTIONAL PARENTS**

Legend:

Physical Relation:




Physical Asset

Functional Relation:



System

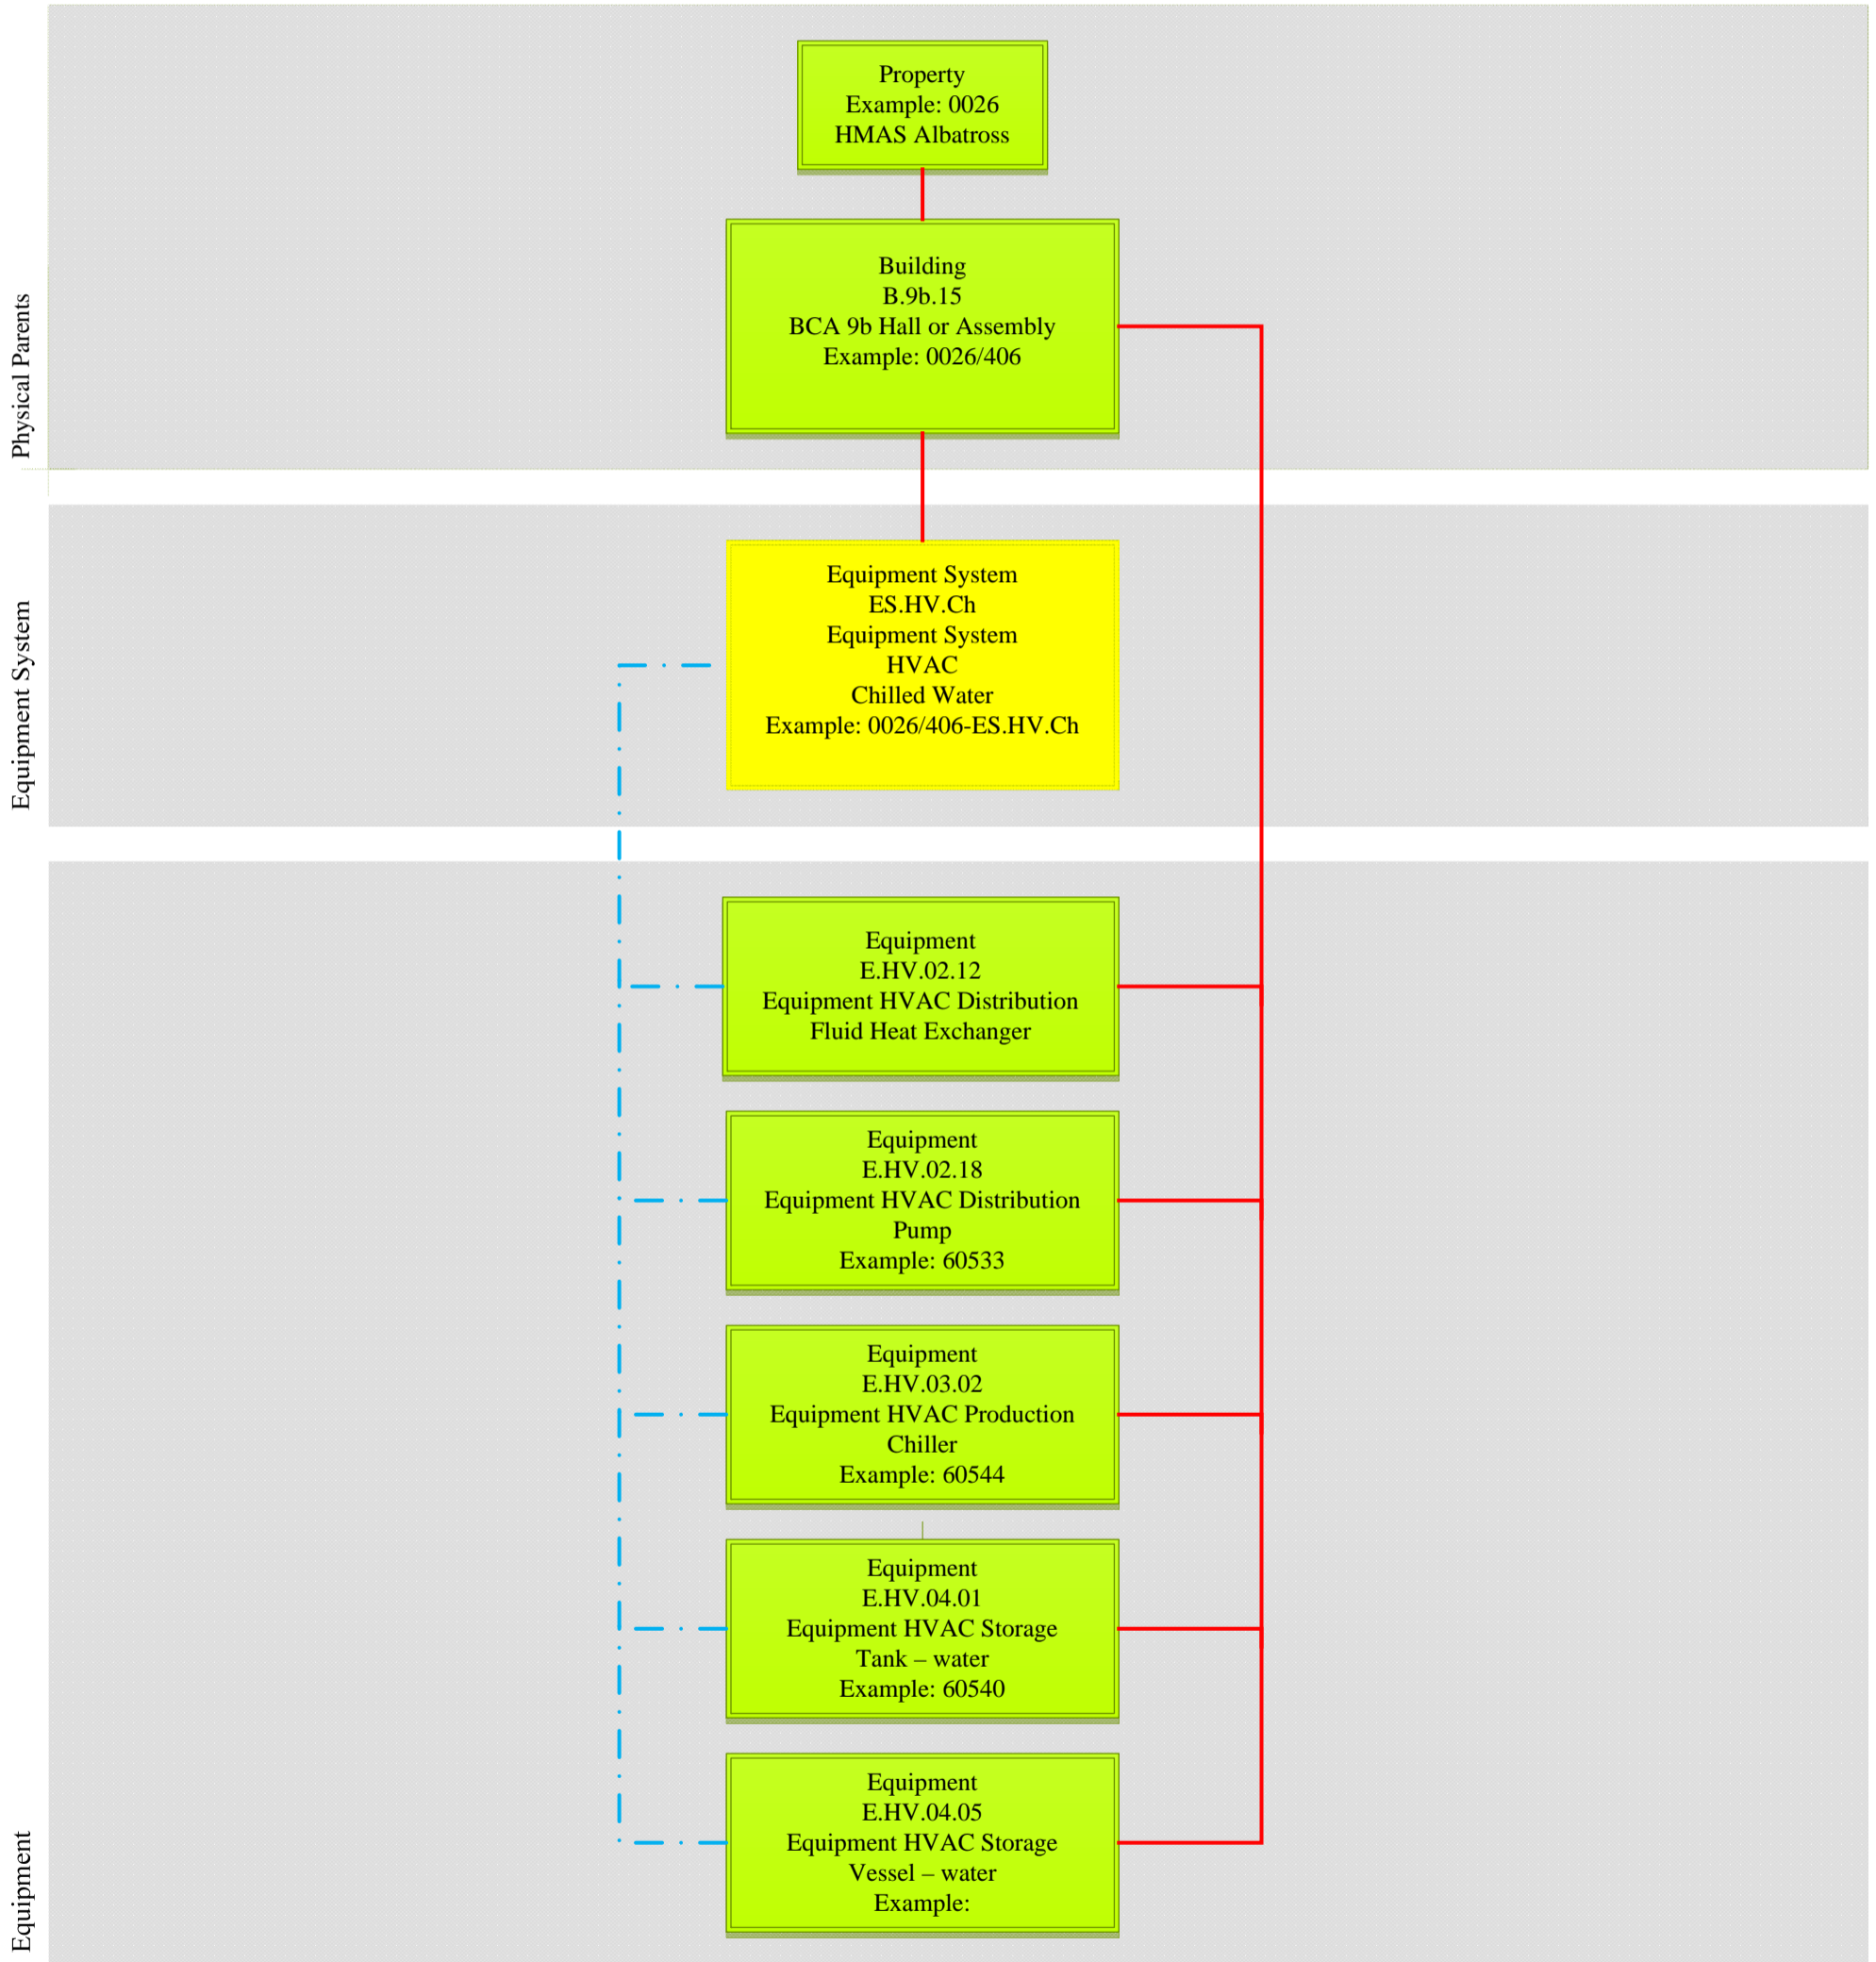

Note:

Registrable Plant Attributes / Characteristics are to be recorded against the Equipment items;

E.HV.02.12 – Fluid Heat Exchanger

E.HV.03.02 – Chiller

E.HV.04.05 – Vessel Water